

Catalyst Additives to Enhance Mercury Oxidation and Capture

Quarterly Report

Period of Performance:

October 1st, 2005 through December 31st, 2005

Prepared by

Thomas K. Gale

April 2006

DE-FC26-04NT41900

Southern Research Institute
2000 Ninth Avenue South
P. O. Box 55305
Birmingham, AL 35255-5305

Prepared for

Bruce Lani
National Energy Technology Laboratory
United States Department of Energy
626 Cochran's Mill Road
Pittsburgh, PA 15236-0940

and

NETL AAD Document Control
Bldg. 921 U.S. Department of Energy
National Energy Technology Laboratory
P.O. Box 10940
Pittsburgh, PA 15236-0940

Disclaimer

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

Abstract

Preliminary research has shown that SCR catalysts employed for nitrogen-oxide reduction can effectively oxidize mercury. Three different SCR catalysts are currently being studied in this project – honeycomb-type, plate-type, and a hybrid-type catalyst. The catalysts were manufactured and supplied by Cormetech Inc., Hitachi America Ltd., and Haldor-Topsoe Inc., respectively. Parametric testing was performed to investigate the contribution of flue-gas chemistry on mercury oxidation via SCR catalysts.

Future work to characterize flue gas simulations typically derived from low and high sulfur bituminous coal are being performed in a stepwise manner, to avoid the constant interruptions in testing that occur when leaks in the system are generated during temperature transitions. Specifically, chlorine concentration vs. mercury oxidation correlations will be developed for each catalyst. The contributions of temperature are also being investigated. SO₂ oxidation is also being investigated for each test condition.

Table of Contents

Introduction	4
Executive Summary	4
Experimental	5
Results and Discussion	8
Conclusion	10
References	10

List of Figures

Figure 1. CTF quartz furnace at ~1000 °C (left) and outside of furnace (right).....	5
Figure 2. Catalyst Test Facility (CTF)	6
Figure 3. CTF gas-flow system	6
Figure 4. From left to right, honeycomb, plate, and hybrid SCR catalysts.....	7
Figure 5. Mercury oxidation comparison of three catalyst types in PRB simulated flue gas	9

List of Tables

Table 1. Test Conditions for PRB Flue Gas	8
Table 2. Comparison of mercury oxidation for three catalyst types	8

Introduction

The objective of this project is to investigate the enhancement of elemental-mercury oxidation in coal-fired flue gas through catalysis. In addition to testing various catalyst materials, fundamental mechanisms associated with enhanced Hg-oxidation on SCR catalysts are being investigated. Where possible, Southern Research will develop semi-empirical mechanistic model(s) or correlations describing the mechanisms associated with catalysis-enhanced mercury oxidation. Results from the project will contribute to a greater understanding of mercury oxidation in flue gas.

Executive Summary

This Quarter, Southern Research Institute continues bench-scale reactor studies to evaluate the behavior of vapor-phase mercury in the presence of Selective Catalytic Reduction (SCR) catalysts. SCR catalysts are employed in coal-fired power plants for the reduction of nitrogen oxide (NO_x) emissions, but SCR catalysts also affect the speciation of other gases, such as mercury. Mercury primarily exists in two-different forms in coal-derived flue gas, HgCl₂ and the elemental form, and each type behaves somewhat differently in the “back-end” pollution control equipment of power plants. Oxidized mercury is readily captured in some of the commonly employed pollution control devices, such as wet scrubbers, while elemental mercury can be more difficult to capture. Therefore, a low-cost method of oxidizing mercury upstream of the wet scrubber is desired for coal-fired power plants that possess a wet scrubber. One of the best options would be a multi-pollutant solution, such as SCR catalysts for NO_x reduction and mercury oxidation, followed by a wet scrubber for mercury and SO₂ capture downstream.

The Catalyst Test Facility (CTF) continues to be used to derive fundamental kinetic information about each catalyst investigated for mercury oxidation and capture. The CTF is described and illustrated in this quarterly report. At the core of the CTF is an extensive flue-gas simulation, gas flow, and metering system. Catalyst samples are supported in a 1-1/2” square (for honeycomb-type and hybrid catalysts) or 1-1/4” x 2” rectangular (for plate-type) Pyrex reactor, through which the entire gas flow must pass. The CTF simulates clean (no particles) flue gas with all the major flue-gas species present, including CO, CO₂, H₂O, O₂, N₂, HCl, NO, SO₂, SO₃, and Hg⁰, in concentrations representative of that found in flue gases of existing power plants, burning specific coal types.

The simulated flue gas originates from compressed-gas cylinders. The gases from the cylinders are then mixed to known concentrations by use of precision mass-flow controllers. The appropriate moisture content is generated through precise control of water evaporation. Mercury is added to the system with a PS Analytical 10.534 Mercury Calibration System, which consists of a reservoir containing an inert substrate impregnated with elemental mercury maintained at constant temperature. The mercury reservoir supplies a saturated stream of elemental mercury which is diluted before mixing with the other gases. The simulated flue-gas stream is well mixed and preheated before entering the reaction chamber. A 3-inch diameter by 3-feet long tube furnace heats the reactor, which allows the simulated flue gas to pass through the furnace while holding the catalyst samples in place.

Bench-scale SCR catalyst tests were conducted to elucidate the relationship between the SCR catalysts and mercury speciation under particular flue-gas environments. The testing procedures were established in the last quarter of 2004 and continue to be used during the current

experiments. These procedures were described in the January 2005 Quarterly Report. The procedures described in that report were adjusted, based on discoveries made in the first quarter of 2005, described in the April 2005 Quarterly Report, and the test procedures were adapted again in the last quarter (2nd Quarter of 2005). Previously, it was discovered that ammonia greatly inhibited the oxidation of mercury. Comparative graphs are presented in this report. Simulated PRB flue gas was the main gas investigated in last quarter. All of the catalysts showed very low mercury oxidation which is probably due to the low chlorine concentrations (5 ppm). Under PRB flue gas conditions, the plate- and hybrid-type catalysts oxidized a larger percentage of the mercury than the honeycomb-type catalyst. Interestingly, the plate- and hybrid-type were also the only catalysts that significantly converted SO_2 to SO_3 .

Next quarter, a chlorine concentration vs. mercury oxidation graph will be developed for each catalyst. Hydrochloric acid vapor has been shown to be the primary promoter of mercury oxidation across SCR catalysts, under unaltered coal-fired flue gas. Each catalyst will be tested across the range of HCl concentrations that are expected to be produced from coals fired at full-scale power plants. Also, the propensity of each catalyst to oxidize SO_2 as well as mercury will be more closely investigated.

Experimental

Figures 1-3 show pictures of the CTF's quartz furnace (micro-reactor), gas-conditioning bubblers for mercury speciation and stabilization prior to mercury monitoring, flue-gas continuous emission monitors (CEMs), and gas-flow control systems. Both elemental and total mercury are measured at the outlet of the CTF.

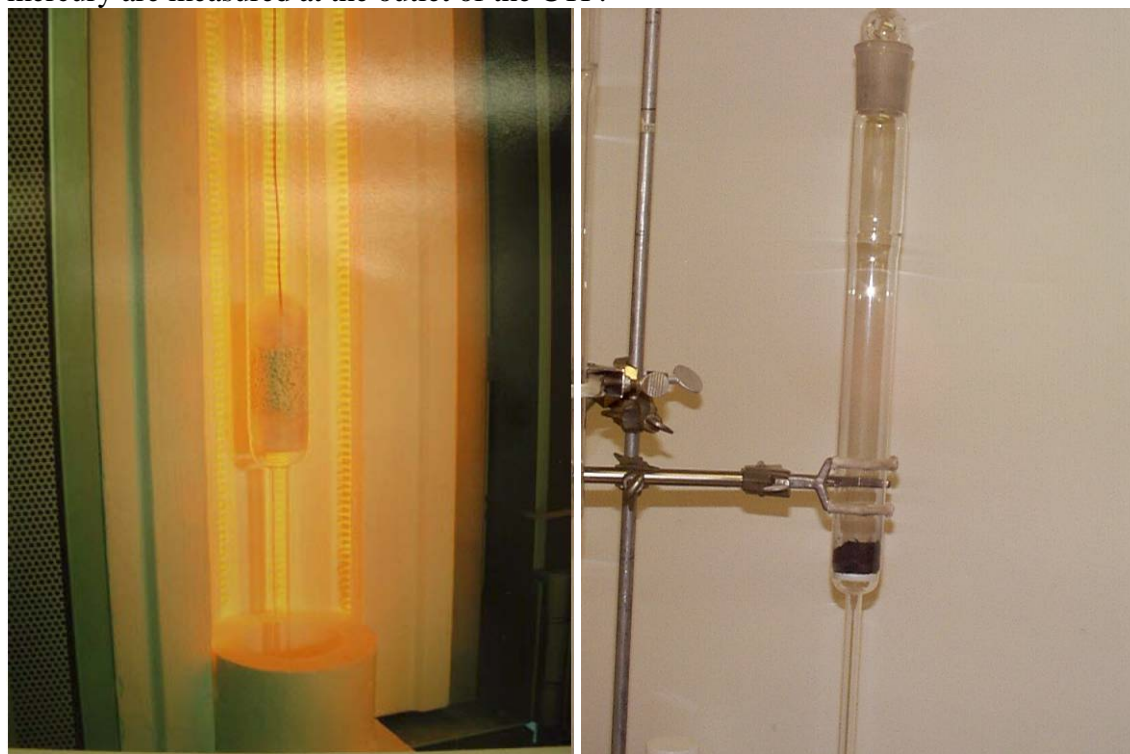


Figure 1. CTF quartz furnace at ~1000 °C (left) and outside of furnace (right).



Figure 2. Catalyst Test Facility (CTF).

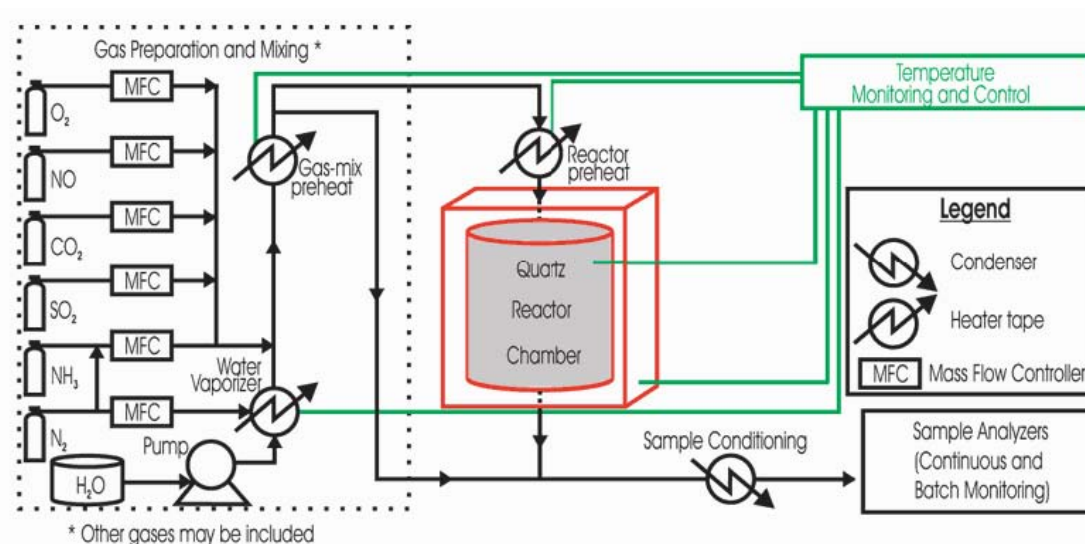


Figure 3. CTF gas-flow system.


The CTF simulates particulate-free flue gas with all the major flue-gas species present, including CO , CO_2 , H_2O , O_2 , N_2 , HCl , NO_x , SO_2 , SO_3 , and Hg^0 , in concentrations that exist in the flue gases of existing power plants, burning specific coal types. The simulated flue gas originates from compressed-gas cylinders. The gases from the cylinders are then mixed to known concentrations by use of mass flow controllers. The appropriate moisture content is

generated through precise control of water evaporation. Mercury is added to the system with a PS Analytical 10.534 Mercury Calibration System, which consists of a reservoir containing an inert substrate impregnated with elemental mercury maintained at constant temperature. The mercury reservoir supplies a saturated stream of elemental mercury which is diluted before mixing with the other gases. The simulated flue-gas stream is well mixed and preheated before entering the reaction chamber. A 3-inch diameter by 3-foot long tube furnace heats the reactor, which allows the simulated flue gas to pass through the furnace while holding the catalyst samples in place. Examples of the three different catalyst types are shown in Figure 4.



Figure 4. From left to right, honeycomb, plate, and hybrid SCR catalysts.

The majority (i.e., over 95%) of NO_x in the flue gas of coal-fired boiler systems is in the form of NO . Hence, NO is generally used in this work to simulate the NO_x in the flue gas, except for experiments specifically conducted to observe the effect of NO_2 . In such cases, mixed NO/NO_2 gas bottles will be used to simulate the NO_x in the flue gas. With only NO in the flue gas, the NO_x reduction reaction is simplified to the following:



All heated sections of the micro-reactor within the CTF system are made of quartz glass to limit side reactions that might occur as a result of wall effects. A semi-continuous emission monitor (SCEM) is employed to detect the mercury levels exiting the reaction chamber. A gas-conditioning system is used to convert all Hg into the elemental form, for detection using a combined gold-trap and atomic fluorescence monitor. A Tekran Model 2573A Mercury Vapor Analyzer is used to detect the elemental mercury. Along with mercury, simultaneous measurements of oxygen, carbon dioxide, nitrogen oxides, and sulfur dioxide are made using continuous emission monitors.

For details concerning the validation and operation of the CTF, refer to the March 04 DOE Quarterly Report for the Calcium-Based Hg -Sorbents project conducted at Southern Research Institute [1] and a previous Quarterly Report on this project [2].

All data in this report was generated using simulated PRB flue gas.

Table 1. Test Conditions for PRB Flue Gas.

<u>Parameter</u>	<u>Value</u>	<u>Units</u>
Temperature	650, 700, and 750	°F
Flow rate	7.5	slpm (@ 70°F and 1 atm)
Gas Concentrations	Simulated Powder River Basin Flue Gas	
<i>Oxygen</i>	5	% (dry, by volume)
<i>Carbon Dioxide</i>	15	% (dry, by volume)
<i>Nitric Oxide</i>	300	ppm (dry, by volume)
<i>Ammonia</i>	0/300	ppm (dry, by volume)
<i>Sulfur Dioxide</i>	500	ppm (dry, by volume)
<i>Hydrogen Chloride</i>	5	ppm (dry, by volume)
<i>Mercury</i>	10	µg/Nm ³ (dry)

Results and Discussion

Table 2 contains the data for three different catalyst types, examined under PRB simulated flue gas, which are intended to provide a comparison of the three catalysts.

Table 2. Comparison of mercury oxidation for three catalyst types in simulated PRB flue gas.

Catalyst	Hg^o (ug/m³)	Hg^T (ug/m³)	Oxidized Hg (ug/m³)	Oxidized Hg/ Hg^T	Oxidized Hg/ average blank Hg^T	Date
blank @ 650°	8066	10898	2832	26.0%	27.1%	8/2/2005
blank @ 750°	7193	9844	2650	26.9%	25.4%	7/18/2005
blank @ 750°	8532	10132	1600	15.8%	15.3%	8/6/2005
blank @ 750°	7955	10911	2956	27.1%	28.3%	8/12/2005
average blank	7936	10446	2510	24.0%	24.0%	-
Honeycomb @ 650°F	10313	10937	624	5.7%	6.0%	8/2/2005
Honeycomb @ 700°F	9646	10502	857	8.2%	8.2%	8/4/2005
Honeycomb @ 750°F	10118	10506	388	3.7%	3.7%	8/5/2005
Hybrid @ 650°F	5724	7606	1882	24.7%	18.0%	8/8/2005
Hybrid @ 700°F	8620	9445	825	8.7%	7.9%	8/7/2005
Hybrid @ 750°F	10026	10450	424	4.1%	4.1%	8/6/2005
Plate @ 650°F	4674	7088	2414	34.1%	23.1%	8/12/2005
Plate @ 700°F	8228	11574	3346	28.9%	32.0%	8/11/2005
Plate @ 750°F	10807	11436	629	5.5%	6.0%	8/12/2005
Honeycomb @ 750°F w/o SO₂	12286	12800	515	4.0%	4.9%	7/18/2005
Honeycomb @ 750°F w/o NH₃	3942	8522	4581	53.7%	43.8%	7/14/2005

Averages were taken over two hours when a catalyst was in the reactor and an hour for the blanks. Three chloride samples were taken by bubbling gas through a carbonate bicarbonate impinger in an ice bath. Ion chromatography was used to determine the chloride mass in each sample. The three samples were 5.9, 4.3, and 5.1 ppm. Because of this low precision and accuracy (2 ppm was the target), future tests will use a mass flow controller instead of a rotameter, in an effort to more precisely meter the injection of HCl into the system. SO₃ samples were taken using controlled condensation. All measurements of the plate and hybrid catalysts

yielded approximately 15 ppm of SO₃; however, only at 750°F did the honeycomb catalyst show any appreciable conversion of SO₂, which yielded only 5 ppm SO₃.

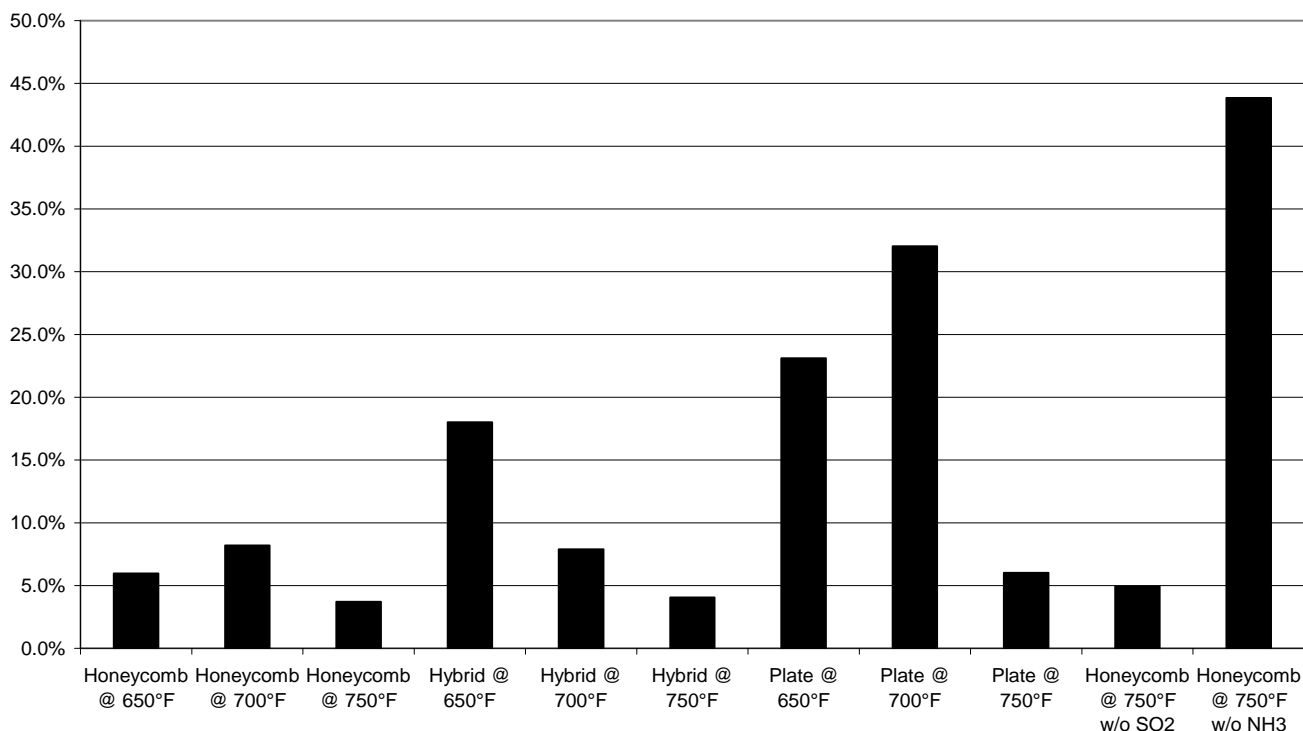


Figure 5. Mercury oxidation comparison of three catalyst types in PRB simulated flue gas.

For the given condition, the plate catalyst oxidized the most mercury, followed closely by the hybrid catalyst. Interestingly, the particular honeycomb catalyst sample tested yielded both the lowest mercury oxidation and lowest SO₂/SO₃ conversion. The most effective temperature for mercury oxidation across the plate and hybrid catalysts was found to be at 700°F. All catalysts showed the lowest oxidation at 750°F.

As mentioned in earlier reports, ammonia inhibits mercury oxidation across SCR catalysts. Additional evidence has been gathered on this mechanism. The honeycomb catalyst at 750° F oxidized 43.8% of the mercury without ammonia and only 3.7% with ammonia. Also, the same test was done with ammonia but without SO₂; the mercury oxidation was 4.9%. The Hg-oxidation difference with an without SO₂ present (4.9% - 3.7%) was within the uncertainty of the data. The average mercury oxidation with a blank reactor with no ammonia was 24.0%, which means that, in the presence of low chlorine concentrations, ammonia inhibited oxidation more than a blank reactor without ammonia. Because of the formation of sulfates, it is impractical to use the blank reactor with ammonia and SO₂; however, for future tests, a blank will be run with ammonia and without SO₂.

Conclusions

Preliminary tests with high chlorine (250 ppm), high sulfur (2500 ppm SO₂) flue gas indicate that oxidation is 80% and above with a blank reactor. This oxidation is too high to accurately compare the three catalysts. Additional preliminary tests with a blank reactor were done by increasing the HCl concentration incrementally from 0 to 250 ppm. Although equipment failure prevented the test from being completed, the preliminary test showed a somewhat linear relationship with mercury oxidation and HCl concentration. This preliminary result, combined with data showing the relatively minute contribution of SO₂, suggests that a better test may come from concentrating more on varying HCl concentration than temperature and other flue gas constituents. This will be done by setting the reactor to 700°F, setting SO₂ to a medium level (~1000 ppm) with the other constituents at the PRB levels, and monitoring mercury with HCl levels of 25, 50, and 100 ppm with each catalyst. Because the temperature will not vary, there would be fewer leaks to cause delays in testing. At the completion of these tests, further tests would be done to quantify repeatability and the relationship of temperature and SO₂ to mercury oxidation and SO₃ formation. At low chlorine levels (i.e., PRB type flue gas), the plate and hybrid catalyst samples oxidized more mercury than the honeycomb catalyst sample. However, the honeycomb-type catalyst sample converted less SO₂ to SO₃.

References

1. Gale, T. K., "Catalyst Additives to Enhance Mercury Oxidation and Capture" Quarterly Report – DE-FC26-04NT41900 for period Mar. 1st through June. 30th, 2004.
2. Gale, T. K., "Mercury Control with Calcium-Based Sorbents and Oxidizing Agents" Quarterly Report – DE-PS26-02NT41183 for period Jan. 1st through Mar. 31st, 2004.
3. Gale, T. K. and Merritt, R. L., "Coal Blending, Ash Separation, Ash Re-Injection, Ash Conditioning, and Other Novel Approaches to Enhance Hg Uptake by Ash in Coal-Fired Electric Power Stations" *International Conference on Air Quality IV, Mercury, Trace Elements, and Particulate Matter*, Arlington, VA, September 22-24, 2003.
4. Gale, T. K., "Mercury Control with Calcium-Based Sorbents and Oxidizing Agents" DOE Mercury Control Technology R&D Program Review Meeting, Aug. 12-13, 2003.
5. Gale, T. K., "Mercury Control with Calcium-Based Sorbents and Oxidizing Agents" Quarterly Report – DE-PS26-02NT41183 first three Quarterly Reports in 2003.
6. Gale, T. K., "Effective Calcium-Based Sorbents for Mercury Control", *EPRI-DOE-EPA-A&WMA Combined Utility Air Pollution Control Symposium: The MEGA Symposium*, Washington D.C., August 30-September 2 (2004).

7. Niksa, S., Helble, J. J., Fujiwara, N., “Kinetic Modeling of Homogeneous Mercury Oxidation: the importance of NO and H₂O in predicting oxidation in coal-derived systems”, *Environ. Sci. Technol.*, **35**: 3701-3706 (2001).
8. Niksa, S., Fujiwara, N., Fujita, Y., Tomura, K., Moritomi, H., Tuji, T., and Takasu, S., “A Mechanism for Mercury Oxidation in Coal-Derived Exhausts” *J. A&WMA* **52**: 894-901 (2001).
9. Senior, C. L., Chen, Z., and Sarofim, A. F., “Mercury Oxidation in Coal-Fired Utility Boilers: Validation of Gas-Phase Kinetic Models”, *A&WMA 95th Annual. Conference.*, Baltimore MD, (2002).
10. Smith, J. M., “Chemical Engineering Kinetics”, Copyright © 1981 by McGraw-Hill, Inc. ISBN 0-07-058710-8.